

*BEST COPY*

*AVAILABLE*

## LABORATORY REPORT

ABBOT A. HANKS, Inc.

ENGINEERS, ASSAYERS, CHEMISTS, METALLURGISTS  
CONSULTING - TESTING - INSPECTING

ESTABLISHED 1866

624 SACRAMENTO STREET  
SAN FRANCISCO 11, CALIFORNIA  
TELEPHONE GARFIELD 1-1697

File No. 823

Lab. No. 55450

Date May 25, 1953

Sample Hollow Concrete Masonry Units

Tests of hollow concrete  
masonry units submitted

Received 5-19-53

Mark

5-19-53

Submitted by Basalt Rock Co.  
14th & River Streets  
Berkeley, California

Attention: C. W. Rollins

In accordance with your instructions and in compliance with ASTM C140-39 we have made tests of hollow concrete masonry units submitted to our laboratory on 5-19-53. Our results are as follows:

Lab. No. 55450

Material: Hollow Concrete Masonry Units

Source: Basalt Rock Co.


Size: 7 5/8 x 13 5/8 x 7 5/8 inch (1 1/4" minimum walls)

<u>Compressive</u> <u>strength, psi</u>	<u>Absorption</u> <u>lb. per cu. ft.</u>	<u>Moisture Content</u> <u>% as received</u>
1. 1392	11.9	6.8
2. 274	11.4	7.5
3. 1186	11.4	17.2
4. 1039	12.4	9.4
5. 1378	11.4	5.8
1194 Average	11.9	9.3

Respectfully submitted,

ABBOT A. HANKS, INC.

BY

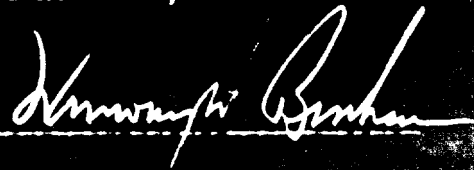

mmh